

# ***NightCool: A Nocturnal Radiation Cooling Concept***

***Danny S. Parker, John R. Sherwin, and Andreas H. Hermelink, Florida Solar Energy Center***

## **ABSTRACT**

An experimental evaluation has been conducted on a night sky cooling system designed to substantially reduce space cooling needs in homes in North American climates. The system uses a sealed attic covered by a highly conductive metal roof (a roof integrated radiator) which is selectively linked by air flow to the main zone with the attic zone to provide cooling – largely during nighttime hours. Available house mass is used to store sensible cooling. Currently, the system's capability for solar dehumidification with minimal electricity input is demonstrated.

## **Introduction**

Radiative cooling to the night sky is based on the principle of heat loss by long-wave radiation from one surface to another body at a lower temperature (Martin and Berdahl, 1984). In many North American locations, the available night cooling exceeds the residential nighttime cooling loads and in arid desert climates may be considerably in excess of total daily cooling requirements.


Careful examination of air conditioner operation in many homes in Florida (Parker, 2002) shows that night sky radiation could substantially reduce cooling needs. Over a 10 hour night, theoretically night sky radiation amounts to about 250 - 450 Wh/m<sup>2</sup> if all could be effectively utilized. However, that is not easily achieved. Various physical limitations (e.g. air flow pattern under the radiator, fan power, convection and roof conductance) limit what can be utilized, so that perhaps half of the potential rate of cooling can be practically obtained. However, passive systems with very little air velocity under the radiator (i.e. with free convection) still will achieve net cooling rates of 1 - 5 W/m<sup>2</sup>. With 200 m<sup>2</sup> of roof in a typical home that adds up to a nearly free cooling rate of 200 - 1,000 Watts (700 - 3,400 Btu/hr).

In addition, the system offers enticing potential for low energy dehumidification. Materials with high humidity absorption placed in the attic, may absorb humidity from the interior during night cooling while exhausting moisture during daytime solar heating.

## **Description of the *NightCool* Concept**

We devised an innovative night cooling system consisting of a metal roof serving as a large area, low mass highly-conductive radiator (see Figure 1). The metal roof is used at night during spring, autumn and acceptable summer periods to perform sensible cooling. Various exotic night sky radiation cooling concepts have been tested in the past. These have included very expensive “roof ponds” or, complex cycles or, movable roof insulation with massive roofs so that heat is not gained during daytime hours (Hay, 1978; Fairey et.al., 1990; Givoni, 1994). The key element of the *NightCool* configuration is that the insulation is installed conventionally on the ceiling. The operation of the system is detailed in Figure 1.

**Figure 1. Schematic of Full Scale *NightCool* Concept**

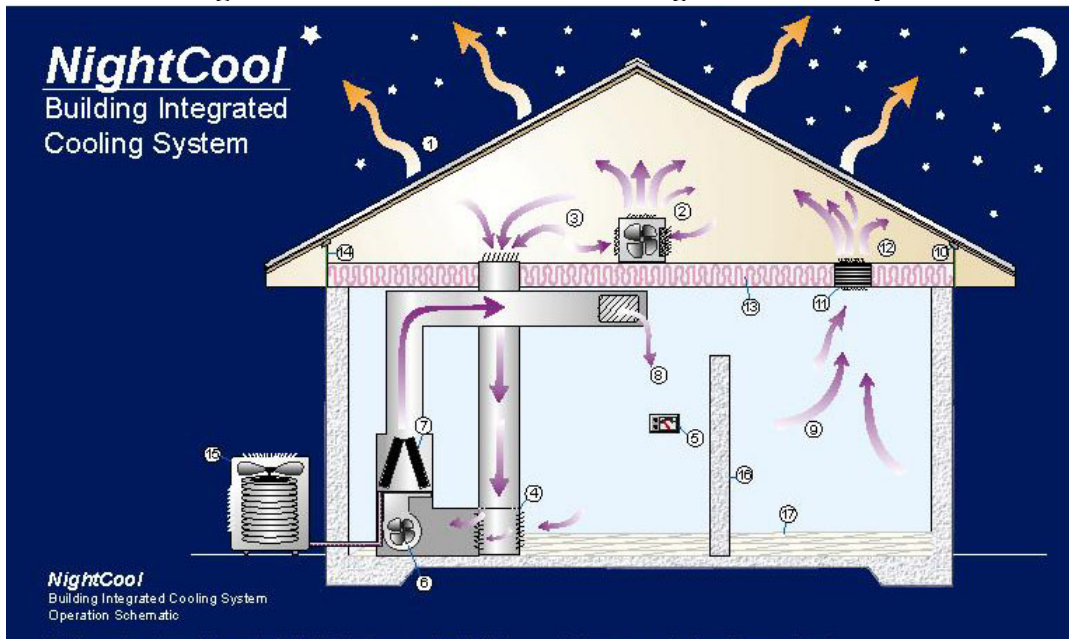

- |  |   |
|--|---|
| 1. White metal roof on metal battens (no decking). Both sides are surfaced for high emissivity. A temperature probe measures roof underside temperature.   | 7. Vapor compression air conditioner cooling coil.                                      |
| 2. Small capacity dehumidifier (such as <i>Whirlpool AD40DBK</i> ); operates only during evening hours when thermostat and roof temperature monitor calls for cooling and attic relative humidity is greater than 55%. | 8. Interior duct system with supply outlet.   |
| 3. Baffled inlet frill from attic for nighttime operation.   | 9. Interior room air return to attic during evening hours when Night Cool is activated. |
| 4. Room return inlet (for daytime operation). Closed by damper at night when temperature conditions are met.   | 10. Roofline drip collection system with drain.   |
| 5. Thermostat (compares roof surface temperature and setting to determine vapor compression vs. nighttime cooling operation).  | 11. Ceiling return for <i>NightCool</i> operation mode.                                 |
| 6. Variable speed air handler fan with electronically commutated motor.  | 12. Attic air connects to cool roof for nocturnal cooling.                              |
|  | 13. R-30 ceiling insulation.  |
|  | 14. Sealed attic construction with top plate baffles (tested and sealed system).        |
|  | 15. Air conditioner outdoor unit (condenser).   |
|  | 16. Concrete interior walls (thermal mass for sensible cool storage).                   |
|  | 17. Tile floor (add thermal mass).  |

During the day, the main zone is de-coupled from the attic, i.e. there is no air exchange and, due to the thick ceiling insulation, there is minimal heat transmission as well. Currently heat gain to the attic space is minimized by the white reflective metal roof. At this time the main zone is conventionally cooled with an appropriately sized air conditioner. However, at night as the interior surface of the metal roof in the attic space falls two degrees below the desired interior thermostat set point, the return air for the air conditioner is channeled through the attic space by way of electrically controlled louvers with the variable speed fan. The warm air from the interior cools off at the interior side of the metal roof which then radiates the heat away to the night sky.

As increased cooling is required, the air handler fan speed or runtime is increased. If the interior air temperature does not cool sufficiently, the air conditioner supplements *NightCool*. Also, if temperature conditions are satisfied, but relative humidity is not, a dehumidifier (note 2 on Figure 1) or other dehumidification system may be energized. The massive construction of the home interior (tile floor and concrete interior walls) stores sensible cooling to reduce space conditioning needs during the following day.

A 225 square meter metal roof structure was modeled for Tampa, Florida (Parker, 2005). The model predicts a cooling rate of about 2,140 Watts (7,300 Btu/hr), an average summer cooling benefit of about 15 kWh per day for 1.4 kWh of fan power and a system seasonal energy efficiency ratio (SEER) of about 37 Btu/Wh (COP = 10.8). Performance in less humid climates with more diurnal temperature swing is predicted to be substantially better. The major weather-

related influences on achieved cooling performance are outdoor air temperature, dewpoint temperature, cloudiness and wind speed. Physical factors with a large influence are the system return air temperature (and hence radiator temperature) air flow rate and fan and motor efficiency.

## Small Scale Test Buildings

To verify the potential of the *NightCool* concept, it is being tested in two 12 x 16' (3.7 x 4.9 m) test structures (192 ft<sup>2</sup> or 17.8 m<sup>2</sup>) of conditioned area. These highly instrumented buildings are located at the Florida Solar Energy Center (FSEC) in Cocoa, Florida. Figure 2 shows the completed side by side test buildings.

**Figure 2. Completed Side-by-Side Test Buildings at Florida Solar Energy Center**



The control building has dark brown asphalt shingles with a solar reflectance of 8% over a standard ½" (1.2 cm) plywood decking on rafters. The vented attic in the control building has 1:300 soffit ventilation. The ceiling is insulated with ten-inch R-30 ft<sup>2</sup>·h·°F/Btu (RSI 5.3 m<sup>2</sup>·K/W) fiberglass batts over ½" (1.2 cm) dry wall.

The experimental unit has a white metal 5-vee roof on metal battens and a sealed attic, which can be convectively linked to the main zone by a powered circulation fan. The white metal roof had an initial solar reflectance of 65% (see Figure 2). Figure 3 shows an interior view of the experimental *NightCool* facility's roof. Note the sealing of the soffit vents with insulation inserts and sealant foam. The white metal roofing is installed on metal battens so that it is directly exposed to the attic below. This produces strong radiation and convective linkage between the fully exposed roof and the sealed attic interior.

**Figure 3. Interior Detail of Experimental *NightCool* Sealed Attic with Exposed Metal Roofing on Metal**



Both units have uninsulated 6" (15 cm) concrete slab floors with an area of 192 square feet (17.8 m<sup>2</sup>). The frame walls in both are insulated with R-13 (RSI 2.3) fiberglass batt insulation, covered with R-6 (RSI 1.1) exterior isocyanurate sheathing, and protected by beige concrete board lapped siding.

Each test building has four 32" x 32" (0.81 x 0.81 m) double-glazed solar control windows. The single-hung windows have air leakage rating of 0.1. These have a NFRC rated overall U-factor of 0.35 Btu/(hr·ft<sup>2</sup>·°F) (1.99 W/m<sup>2</sup> · K) a solar heat gain coefficient of 0.35 and a visible transmittance of 60%. The windows are covered with white interior blinds. To approximate typical internal mass in residential buildings, twenty hollow core concrete blocks were located on the north side of both buildings.

On October 20, 2006, we used SF<sub>6</sub> tracer gas to test the *in situ* infiltration rate of the control and *NightCool* buildings with the air conditioning off, but with the *NightCool* air circulation grills open. The measured infiltration rates were 0.27 ACH in the control and 0.34 ACH in the *NightCool* test building – a fairly similar result.

### **Instrumentation and Monitoring**

An extensive monitoring protocol was developed for the project as shown in the full project report (Parker et al., 2007). Room temperature and humidity conditions are measured in each building. Also, a key measurement in the *NightCool* building involves measuring air mass flow with the return and supply temperatures from the sealed attic space under the radiatively coupled roof. Weather parameters include temperature, humidity, insolation, wind-speed and a pyrgeometer are used to determine potential night cooling along with nighttime heat dissipated to the integral night sky radiator system.

Small 5,000 Btu/hr (1.46 kW) room air conditioners are installed to supply supplemental cooling. Internal loads are simulated by switching on and off interior lamps using wall timers and a calibrated room humidifier. Electricity consumption data is collected for air conditioner, internal loads and *NightCool* fan power.

## Components and Control of *NightCool* Circulation System

Two ceiling mounted registers were cut out from the R-30 SIPs panel ceiling of the experimental building. A *Fantech FR125* centrifugal fan (148 cfm or 70 L/s, 18 Watts) was installed on one side to circulate air from the main zone to the attic space when temperature conditions are met. Generally the *NightCool* system is activated when the attic air temperature falls below 74°F (23.3°C). To maintain the main interior zone under a positive pressure, the fan drew air from the sealed attic with return air entering from a passive register on the opposite side of the room.

Prior to the long term monitoring, two motorized 16-inch (0.4 m) dampers were added to the supply and return air respectively so that the air from the main zone to the attic is closed when the attic is at a higher temperature than the main zone or when the attic is being ventilated.

The dampers are open for passive cooling when the attic is cooler than the main zone (warm air rises to the *NightCool* attic and then falls as it is cooled to the main zone). Always, when the attic temperature drops below 75°F (23.9°C) the dampers are open for cooled air to circulate to the main zone.

Both the experimental and control buildings are cooled by two small window unit air conditioners. These AC systems are operated by the data acquisition system to obtain very fine temperature control of the interior space which is set to 78°F (25.6°C). These have a nominal capacity of 5,000 Btu/hr (1.46 kW) and an EER of 9.7 Btu/Wh (COP = 2.84). Based on measurements we determined that they draw about 520 Watts when running at 85°F (29.4°C) outdoor condition.

### *NightCool* Controls

The monitoring in 2007 evaluated the fully operational *NightCool* system with supplemental air conditioning used when interior temperatures rose above 78°F (25.6°C). The *NightCool* activation conditions are:

- Attic Temperature < 75.5°F (24.2°C)
- Attic Temperature < Interior air temperature
- Interior Air Temperature > 74°F (23.3°C)


Conditions are evaluated every 10 seconds with a decision made every five minutes in terms of whether air conditioning or *NightCool* is activated. When *NightCool* is on, the air conditioning system is turned off. Conversely, if the indoor air temperature is above 78°F (25.6°C), the room air conditioner is activated and *NightCool* fans cannot be activated. As set up, the *NightCool* system will cool the interior space down to 74°F (23.3°C), prior to being turned off. The cut off prevents overcooling of the conditioned interior.

### Typical Daily Performance


The two figures below illustrate the performance of the *NightCool*. The data show performance on 12 April 2007 under good performance conditions for the *NightCool* concept. Figure 4 shows the recorded weather temperature conditions on this relatively clear spring day. There was very warm weather in the afternoon with a good amount of cooling necessary in both

buildings. The air temperature reaches a maximum of 85.5°F (29.7°C), with relatively high moisture (dewpoint averages 69°F or 20.6°C). However, with a clear sky the measured sky temperature drops below 50°F (10°C) after sunset – ideal for nocturnal cooling.

**Figure 4. Outdoor Temperature Conditions on 12 April 2007**

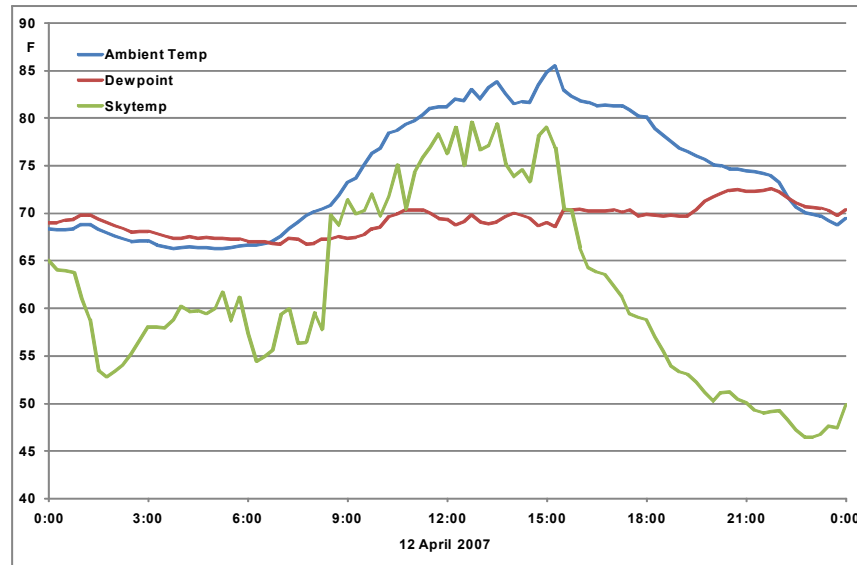

**Figure 5. Control vs. *NightCool* HVAC Power on 12 April 2007**

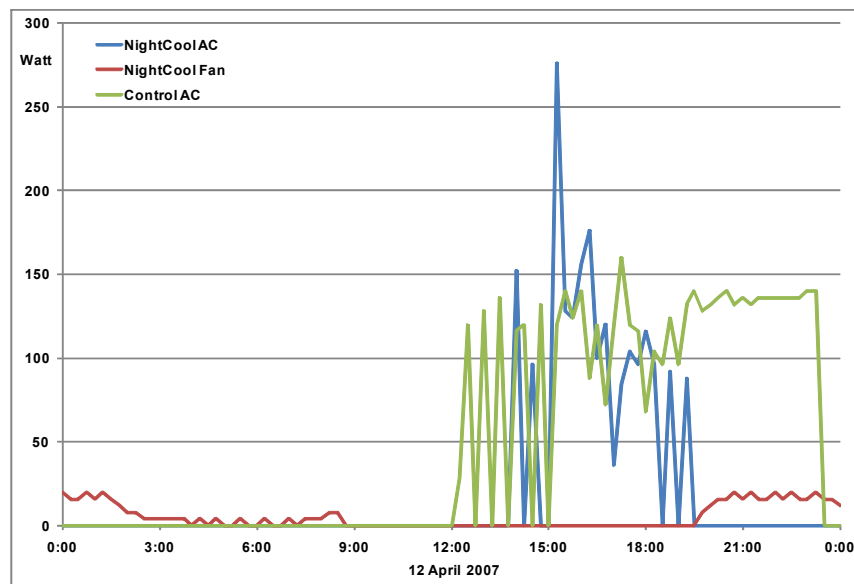


The second plot, Figure 5, plots the measured air conditioner and *NightCool* fan power. Over the course of the day, *NightCool* reduced cooling use by 48% including the energy use of the circulating fans. The control building used 1.22 kWh for cooling over the day while the air conditioner in *NightCool* used 0.51 kWh and the fans another 0.12 kWh. Also, the experimental system produced better comfort with lower and more even interior air temperatures.



## Measured Long-Term Performance


Below, we summarize the collected data for a full year for the cooling season in Central Florida, which stretches from April to November of 2007. Within the monitoring, mechanical air conditioning used in the control and the experimental unit during daytime, and with the *NightCool* fan circulation system used during evenings. A daytime temperature of 78°F (25.6°C) was maintained in both test buildings. Air conditioner cooling energy use averaged 4.6 kWh/day in the control building against 3.6 kWh in the experimental building, which also used 0.2 kWh/day for the circulation fans. Measured cooling energy savings between the control and *NightCool* building averaged 15% over those 8 months. The comparative profiles of measured performance over the 24-daily cycle from April to November are shown in Figure 6. Note that a 15% energy savings is seen regardless of the fact that the *NightCool* system averages an interior air temperature about half a degree cooler than in the control.

**Figure 6. Comparative Cooling Performance of the Control and *NightCool* Building Air Conditioning System and System Fans over the Daily Cycle**

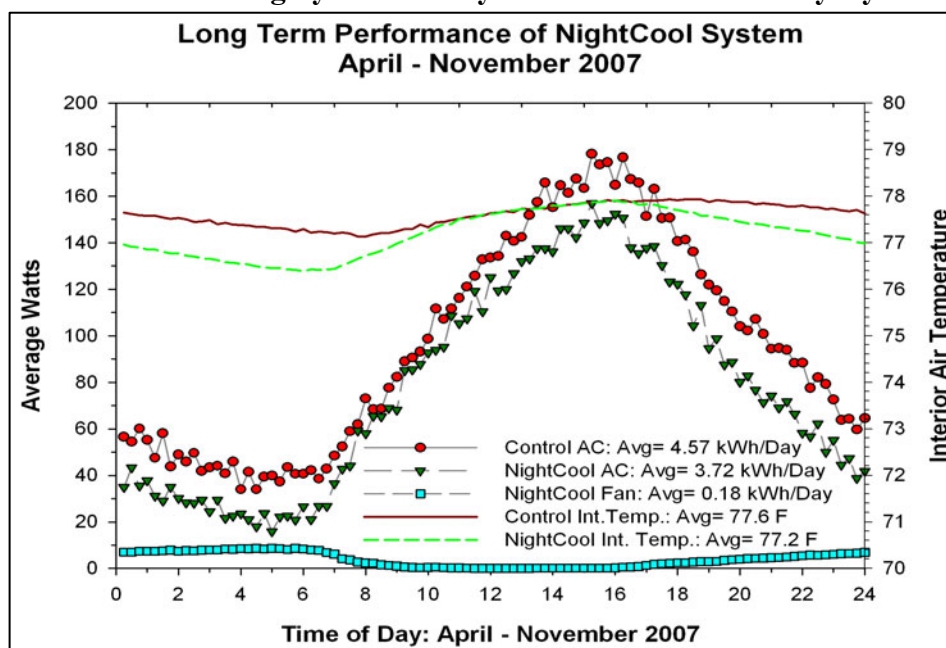

The delivered seasonal cooling rate averaged about 1.5 - 3.0 Btu/hr/ft<sup>2</sup> (5 - 10 W/m<sup>2</sup>) of roof surface on the average evening, implying that *NightCool* in a full scale 2,000 square foot (186 m<sup>2</sup>) home would cool at a rate of 4,000 - 8,000 Btu/hr (1170-2340 W) depending on the season. Over a typical 6 hour operating period, this would produce about 0.2 ton-hours of sensible cooling or 2 ton-hours (7.0 kWh) in a full scale home.

**Figure 7. Monthly Average Performance of *NightCool* System in 2007**

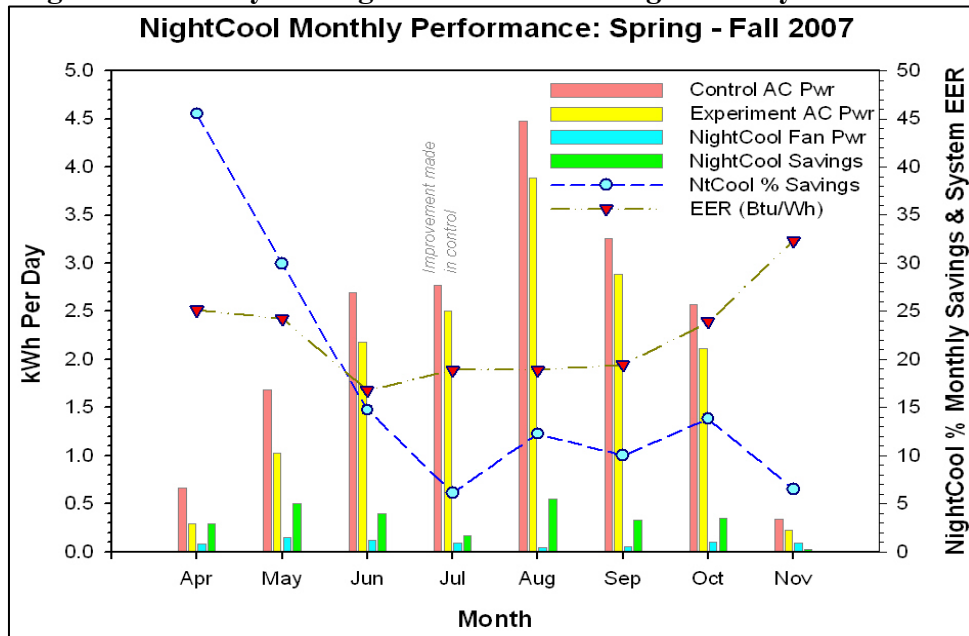

**Table 1. *NightCool* Performance 2007**

Power & Efficiency								
	<i>April</i>	<i>May</i>	<i>June</i>	<i>July</i>	<i>August</i>	<i>September</i>	<i>October</i>	<i>November</i>
Experiment AC (kWh/day)	0.292	1.027	2.176	2.507	3.886	2.881	2.109	0.224
Experiment Fans (kWh/day)	0.080	0.151	0.121	0.094	0.046	0.049	0.104	0.095
Control AC (kWh/day)	0.683	0.682	2.694	2.767	4.481	3.257	2.567	0.341
Experiment Lights (kWh/day)	2.723	0.682	2.660	2.575	2.641	2.698	2.693	2.694
EER (Btu/Wh)	24.6	23.9	16.5	18.6	18.6	19.3	23.6	31.8
RTF (run-time-fraction)	0.185	0.358	0.291	0.216	0.120	0.118	0.250	0.227
T (°F) ( $T_{\text{return}} - T_{\text{supply}}$ )	2.73°	0.65°	1.83°	2.07°	2.07°	2.14°	2.62°	3.53°
Percent <i>NightCool</i> Savings	45.5%	0.0%	14.7%	6.0%	12.3%	10.0%	13.8%	6.5%
Building Conditions								
	Avg	Avg	Avg	Avg	Avg	Avg	Avg	Avg
Experiment Attic Temp. (°F)	73	79.9	83.8	85.2	86.2	83.5	80.8	68.5
Control Attic Temp (°F)	81.0	85.7	90.0	91.8	94.9	89.2	85.6	74.7
Experiment Room Temp. (°F)	77.3	78.9	80.1	79.9	74.6	79.2	79.1	76.5
Control Attic Temp. (°F)	77.9	79.1	79.2	79.0	78.7	78.6	78.6	77.0
Experiment Room RH (%)	47.5	45.4	44.0	43.9	39.5	41.8	46.7	53.0
Control Room RH (%)	45.1	40.5	40.3	41.9	39.2	42.7	44.4	54.8
Weather Conditions								
Ambient Temp. (°F)	69.6	74.5	78.5	79.9	82.9	80.2	78.3	67.5
Ambient RH (%)	67.3	68.5	77.7	82.9	6.3	79.7	79.4	76.3
Solar (w/m <sup>2</sup> )	250.0	253.5	235.0	210.9	235.5	181.6	150.5	151.6
Dewpoint (°F)	57.9	64.0	71.6	74.9	75.0	73.6	71.7	59.8
Sky Temp. (°F)	50.1	58.6	66.8	70.5	70.8	69.6	67.7	49.0

*NightCool* Fan run-time fraction



Monthly performance indices were also produced. Average long-term monthly energy efficiency ratios (EERs) ranged from 16 - 32 Btu/Wh (COP = 9.7 - 9.4) with a mean of 25 Btu/Wh (COP = 7.3) over the cooling season – somewhat lower than simulations conducted earlier. Figure 7 shows the monthly performance indices in terms of monthly energy savings in absolute and percentage terms as well as the *NightCool* system EER. Table 1 numerically summarizes the detailed performance in terms of energy, efficiency, thermal and comfort related performance.

## Enthalpy-Controlled Solar Attic Ventilation

As *NightCool* provided only sensible cooling, we saw higher interior relative humidity in mid-summer strongly suggesting the need for supplemental dehumidification. However, using even a small amount of standard dehumidifier power would adversely impact the system efficiency since that process is inherently energy intensive. Thus, we conceived use of the solar daytime attic heat to dry attic wood and a clay desiccant with enthalpy controlled ventilation to exhaust the moisture. This approach is similar to the solar dehumidification scheme described by Areemit and Sakamoto (2005), which utilized a plywood attic to achieve effective dehumidification with COPs exceeding 15 – three times as great as the best standard electric dehumidifiers.

Over the project monitoring period, we installed a drying system used in conjunction with *NightCool*. We added 300 clay desiccant packs between the roof and the wood rafter in the attic (see Figure 3). The total net weight of clay desiccant total 900 ounces (56 lbs or 25.6 kg). The desiccant absorb moisture at night when attic temperatures are low and thus relative humidity (RH) is high and desorb moisture during day when attic temperatures are high and RH is low. It is noteworthy, however, that with no way for the moisture to be removed from the building there is only a temporary benefit from adding the desiccant packs unless the attic is ventilated. Therefore four watt DC ventilation fans were added to the otherwise sealed *NightCool* attic – one for supply ventilation feeding in 40 cfm (19 L/s) of outside air from the south east side soffit and the other exhausting warm moist air from the attic western side ridge and exhausting that air out of the north soffit.

In January 2008 we began controlling the experimental facility attic ventilation based on the difference in the attic to outdoor absolute humidity. In this mode of operation, the sun's heat warms the attic and dries the desiccants activating the attic ventilation fans and thereby removing moisture. The status of the fans is determined every five minutes. If the exterior humidity is lower than that inside, the ventilation fans are activated. Otherwise they remain unpowered. During the night the ventilation ends and the desiccant reabsorbs moisture from the space during *NightCool* operation.

## Latent Moisture Capacitance

Even during autumn days, we saw attic temperature exceeding 90°F (32°C) for periods of time during high insolation. However, they do not go much above this temperature level. Thus, a key need is for a workable desiccant material that can be regenerated at low temperatures. Although silica gel is a versatile and proven desiccant, it does not regenerate until temperatures of over 240°F (116°C) are obtained. Consequently, its use is not feasible with the concept. However, available montmorillonite clay desiccants regenerate at temperatures between 90°F


and 120°F (32-49°C), thus at first they were considered ideal. Desiccant clay can hold up to 20% of its dry weight as moisture with a three-hour exposure.

The lower *NightCool* attic temperatures would indicate that potentially a 5-10% usable moisture adsorption potential might be available over a daily cycle in the *NightCool* attic. Given that residential research suggests that a rate of 1.25 gallon per 1,000 ft<sup>2</sup> (5L/100m<sup>2</sup>) of daily moisture removal capacity is needed in a typical home (Tenowolde and Walker, 2001), this would suggest the need for about one liter or about 2 pounds (0.9 kg) of moisture capacity in the 192 ft<sup>2</sup> (17.8 m<sup>2</sup>) *NightCool* building. This would indicate about 20-40 pounds (9-18 kg) of desiccant clay for the application in the test building. Not only does the ventilation remove collected moisture, but it would also lower the temperature of the attic space to reduce daytime sensible cooling loads across the insulated ceiling.

## Solar Dehumidification: Initial Results

Since the change to enthalpy-controlled attic ventilation, we have seen beneficial reduction in relative humidity. Figure 8 shows the measured interior relative humidity in the control and *NightCool* main zone interior after the implementation of enthalpy based attic ventilation in mid January 2008. The data is for 1 February to 2 March 2008.

**Figure 8. Comparative Main Zone RH with Enthalpy Controlled Solar Attic Ventilation**

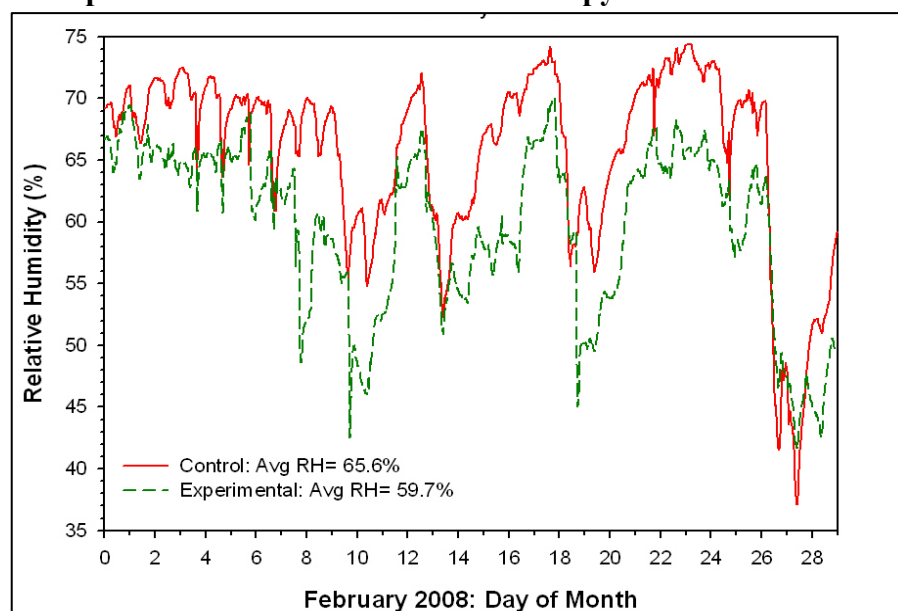


After the enthalpy based ventilation system was activated with the desiccant system, the average February interior main zone relative humidity averaged 65.6% in the control building against 59.7% in the *NightCool* building – a significant reduction in interior relative humidity during a seasonal period of minimal space conditioning. This is also a time where many buildings in Florida otherwise experience moisture problems. So during swing seasons *NightCool* may keep RH below 60% RH without backup dehumidification, which is desirable relative to mold, mildew, dust mites etc. Even during wintertime *NightCool*s additional moisture buffer may be utilized for staying within reasonable RH limits without consuming lots of energy.

## Latest Research Findings

Our latest findings show that even better dehumidification potential may be achieved by replacing the clay packs with wooden fiber boards, usually being used for floor underlayment and sound deadening. The use of this material water for building moisture adsorption has already been previously experimentally demonstrated in research at Germany's Fraunhofer Institute (Künzel et al., 2006). We found that fiber board responds faster to changes in RH than the clay desiccant, RH being the major climate parameter influencing the absorption-desorption process (see Figure 9). Used in the *NightCool* attic, the specific moisture absorption capacity of fiberboard is at least 50% higher compared to clay packs by weight and it is also higher than what can be achieved with standard plywood.

**Figure 9: Comparative Moisture Absorption/Desorption Performance of Clay Desiccant Packs versus Wood Fiber Boards**

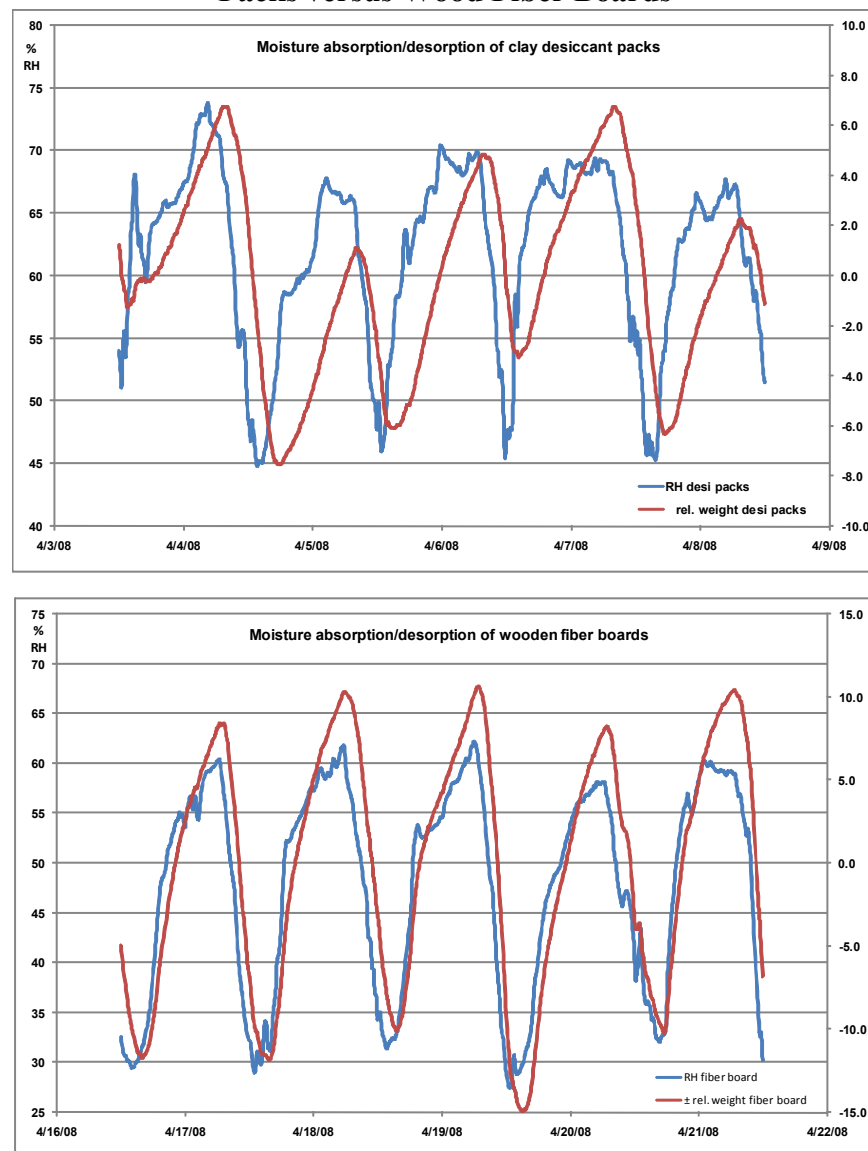

A precision digital scale in the attic of the *NightCool* building logged the weight of desiccant packs or fiber board respectively over several days. Figure 9 shows five day periods, starting and ending at noon. Both samples had an average weight of approximately 900 g. Note that RH range differs due to changing ambient conditions. Linear regression analysis for clay yielded a relative weight change of about 0.46% for each percent RH-change, against a 0.70 % change for the fiber board sample. Confining the comparison to the RH range of 45% to 70%, which occurred during both sampling periods, the advantage of the fiber board becomes even more pronounced. Finally, there is the faster response time of moisture adsorption with the fiberboards. Considering these results, we replaced the clay packs with fiber board by the beginning of May 2008 with immediately observed improvements to daily *NightCool* dehumidification performance.

A major factor for the exploitation of the theoretical night cooling potential is achieving as high as possible a temperature of the metal roof during nighttime. A recent change to pressurizing the attic by pushing the air from the main zone to the attic rather than depressurizing it by doing vice versa resulted in much better performance: first, by this change, the fan's heat is directed to the attic – where it helps heating up the radiator – rather than to the main zone and second by creating more turbulence in the attic the convective heat transfer is improved. Maximum EERs for this new mode ranged between 60-120 Btu/Wh (COP = 18-35) in April and early May 2008 – considerably better than that previously achieved.

As there has been uncertainty about which fraction of the *NightCool* savings is due to night time cooling and which is due to the white metal roof (resulting in lower attic temperatures during daytime), the control building's roof received the same white metal roof in May 2008. Theoretical calculations assuming white roofs on both buildings and the disadvantageous depressurizing configuration of last year resulted in about 10% savings, compared to 15% measured in 2007. And very recently in mid-May, we have observed 23% savings of the *NightCool* system in daily space cooling with both buildings now covered by an identical white metal roof. Also, we have not yet accounted for the energy embodied in the greater moisture removal in the *NightCool* building.

## Potential Future Improvements

When mated with metal roof Building Integrated Photovoltaics (BIPV), the *NightCool* concept shows potential to achieve an integrated roof system providing electric power, as well as supplemental heating and cooling. Conceptually, within this further development of the concept, thin film PV is adhered to metal roofing which then generates electric power. Such systems have been extensively tested by the Florida Solar Energy Center and others.

One disadvantage with most conventional BIPV systems is that when installed on decking, it operates at higher temperatures and thus suffers losses in solar to electrical conversion efficiency (Davis, Fanney and Dougherty, 2001). Typically this represents 5-6% losses relative to bracket-mounted stand-off arrays, depending on module temperature response characteristics. With implementation of BIPV with *NightCool*, the underside of the roofing system would be metal on battens so that BIPV operating temperatures would be beneficially reduced. The transferred heat to the attic would then be removed by daytime powered ventilation from the gable roof ends by small dedicated DC roof fans, whose current task is restricted to remove humidity desorbed by desiccant materials in the attic. Another advantage will be that with

the darker roof system the effectiveness of the solar dehumidification system will even be improved similar to that achieved by Areemit and Sakamoto (2005).

During winter mornings and afternoons, however, collected heat from the darker BIPV would be conveyed by fans as useful heat to the interior space to offset a portion of space heating needs. During summertime periods, daytime heat would be removed by ventilating the attic to improve BIPV operating efficiency and lower ceiling cooling loads. At night, the *NightCool* system would operate conventionally to reduce cooling needs. This would result in a highly desirable building integrated solar power system that would also provide supplemental space cooling and heating (U.S. DOE, 2006).

*NightCool* takes ducts being in the conditioned space for granted to minimize losses. However besides the BIPV a fully integrated cost-efficient *NightCool* building also has to minimize all envelope heat gains (windows, walls, ceiling) and clip daytime peaks through adding sensible storage. These steps are to be introduced in 2009.

## Conclusions

This report describes the experimentally tested potential of a novel residential night cooling concept. *NightCool* uses a home's metal roof under a sealed attic as a large radiator to the night sky to provide effective nocturnal cooling. Measured cooling energy savings between the control and *NightCool* building averaged 15% over the eight month test period-- somewhat lower than the previous simulation analysis. Several measures have been taken recently to get a closer match between the theoretical and practical outcome of the *NightCool* concept. It is noteworthy, the level of performance reported here already exceeds the performance of any air source equipment currently available.

Also, an integrated enthalpy-based ventilation system in the attic with solar drying of low-temperature regenerated desiccants resulted in a significant reduction in interior relative humidity during a period of minimal space conditioning where many buildings in Florida experience moisture problems.

The favorable experimental data collected indicate that *NightCool* can be a promising system technology for very low energy homes. In 2009 we plan to mate the concept with Building Integrated Photovoltaics (BIPV) to provide combined solar electric power, nighttime cooling and winter afternoon heating. Further steps for minimizing heat gains to the interior and clipping daytime temperature peaks will be analyzed to examine the potential to entirely eliminate the conventional air conditioner in appropriate climates.

## Acknowledgment

At Florida Solar Energy Center, Neil Moyer assisted with measurement and evaluation. This work is sponsored by the U.S. Department of Energy (DOE), Office of Energy Efficiency and Renewable Energy, Building America Program. The authors appreciate the support from George James, Ed Pollock and Terry Logee, DOE program managers in Washington, D.C. and Bill Haslebacher, our DOE project officer. It should be noted, however, that the views expressed in this paper do not necessarily reflect those of the U.S. Department of Energy.

## References

- Areemit, N., and Sakamoto, Y., 2005. "Feasibility Study of the Passive Solar Room Dehumidifying System Using the Sorption Property of a Wooden Attic Space Through Field Measurement," International Conference Passive and Low Energy Cooling for Built Environment, May, Santorini, Greece.
- Clark, Gene, 1981. "Passive/Hybrid Comfort Cooling by Thermal Radiation," Passive Cooling: American Section of the International Solar Energy Society, Miami Beach, 1981.
- Davis, Mark W., Dougherty, Brian P., and Fanney, Hunter A., 2001. "Prediction of Building Integrated Photovoltaic Cell Temperatures," Transactions of the ASME, the Journal of Solar Energy Engineering, Special Issue: Solar Thermochemical Processing, Vol. 123, No. 2, pp. 200-210, August 2001.
- Fairey, Philip, W., et al., "An Analytical Assessment of the Desiccant Enhanced Radiative Cooling Concept," FSEC-PF-207-90, ASME 1990 International Solar Energy Conference, Miami, FL, April 1- 4, 1990.
- Givoni, Baruch, 1994. Passive and Low Energy Cooling, Van Nostrand Reinhold, NY.
- Hay, Harold R., 1978. "A Passive Heating and Cooling System from Concept to Commercialization," Proceedings of the Annual Meeting of the International Section of the Solar Energy Society, p. 262-272.
- Künzel, Helmut, Holm, A, and Sedlbauer, K., 2006. "Einfluss feuchtepuffernder Materialien auf das Raumklima," Zeitschrift für Wärmeschutz, Kälteschutz, Schallschutz, Brandschutz, Vol.51 (2006), No.57, pp.26-36, Fraunhofer Institute,
- Martin, Marlo and Berdahl, Paul, 1984. "Characteristics of Infrared Sky Radiation in the United States," Solar Energy, Vol. 33, pp. 321-326.
- Parker, Danny S., 2005. Theoretical Evaluation of the NightCool Nocturnal Radiation Cooling Concept, Submitted to U.S. Department of Energy, FSEC-CR-1502-05, Florida Solar Energy Center, April.
- Parker, Danny S. and Sherwin, John R., 2007. Experimental Evaluation of the *NightCool* Nocturnal Radiation Cooling Concept: Performance Assessment in Scale Tests Buildings, Submitted to U.S. Department of Energy, FSEC-CR-1692-07, Florida Solar Energy Center, January 2007..
- Parker, Danny S., "Research Highlights from a Large Scale Residential Monitoring Study in a Hot Climate." Proceedings of International Symposium on Highly Efficient Use of Energy and Reduction of its Environmental Impact, pp. 108-116, Japan Society for the Promotion of Science Research for the Future Program, JPS-RFTF97P01002, Osaka, Japan, January 2002.
- U.S. DOE, 2006. " Building Integrated Solar Design Review Meeting: Phase 2," NREL/U.S. Department of Energy, Washington, DC, October, 5-6, 2006.